



POWERFACTORY

Co-Simulation

In Power Electronic Dominated Networks

POWER SYSTEM SOLUTIONS
MADE IN GERMANY

- Very fast controls (in comparison with synchronous machines)
- Mostly non-linear controls and manufacturer specific
- Typically grid-following controls, injecting P and Q against voltage magnitude and angle
- Assumptions may be wrong if the connected networks are too weak

→ Concerns are raised that classical RMS-simulations may not be sufficient anymore.

RMS Simulation


- Less modelling efforts
- Fast simulations
- Allows full-scale model simulations
- Less detailed results, which might not show all consequences

EMT Simulation

- High modelling efforts
- High performance impacts
- Typically only parts of networks will be represented
- Full detail assessments are possible if detailed (manufacturer specific) models are available

Co-Simulation as a solution to get the best of both worlds?

- Splitting up the network in multiple sub-networks
- Allowing to consider different parts of the network to be considered in multiple time-domains
- Allowing to make use of multi-processor architecture
- Connecting multiple simulation instances (w/o different simulation tools)

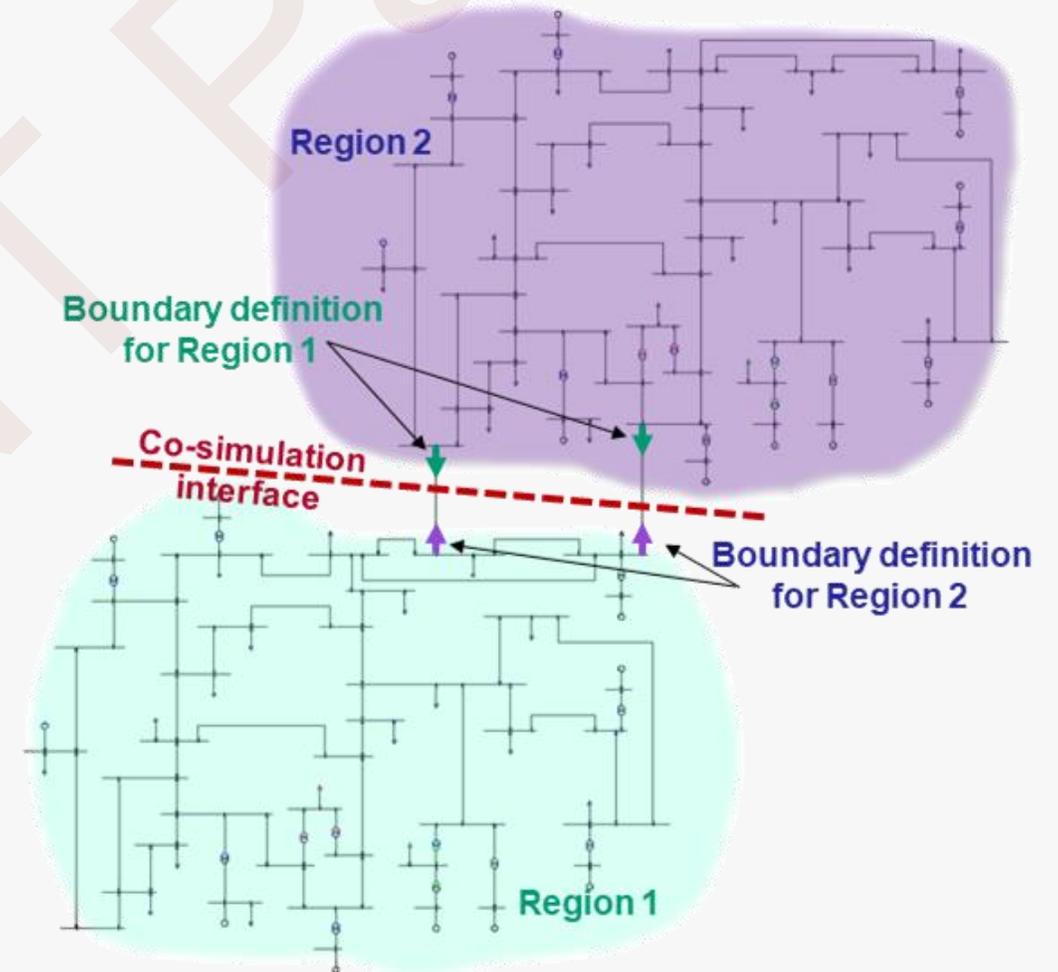

Single Time Domain

- All sub-networks are simulated in the same time domain
 - RMS (balanced)/RMS (balanced)
 - RMS (unbalanced)/RMS (unbalanced)
 - EMT/EMT
- Used to make use of multiple processors

Multiple Time Domain


- Sub-networks are considered in different time domains:
 - RMS (balanced)/ RMS (unbalanced)
 - RMS (balanced)/ EMT
 - RMS (unbalanced)/ EMT
 - RMS (balanced)/ RMS (unbalanced)/ EMT
- Used to split up the network according to needs
- Also makes use of parallel processing

Single- vs Cross-Platform Co-Simulation

Single-platform simulation

- Used on a single platform
- Only uses a single simulation model
- Makes use of a single simulation engine

Cross-platform simulation

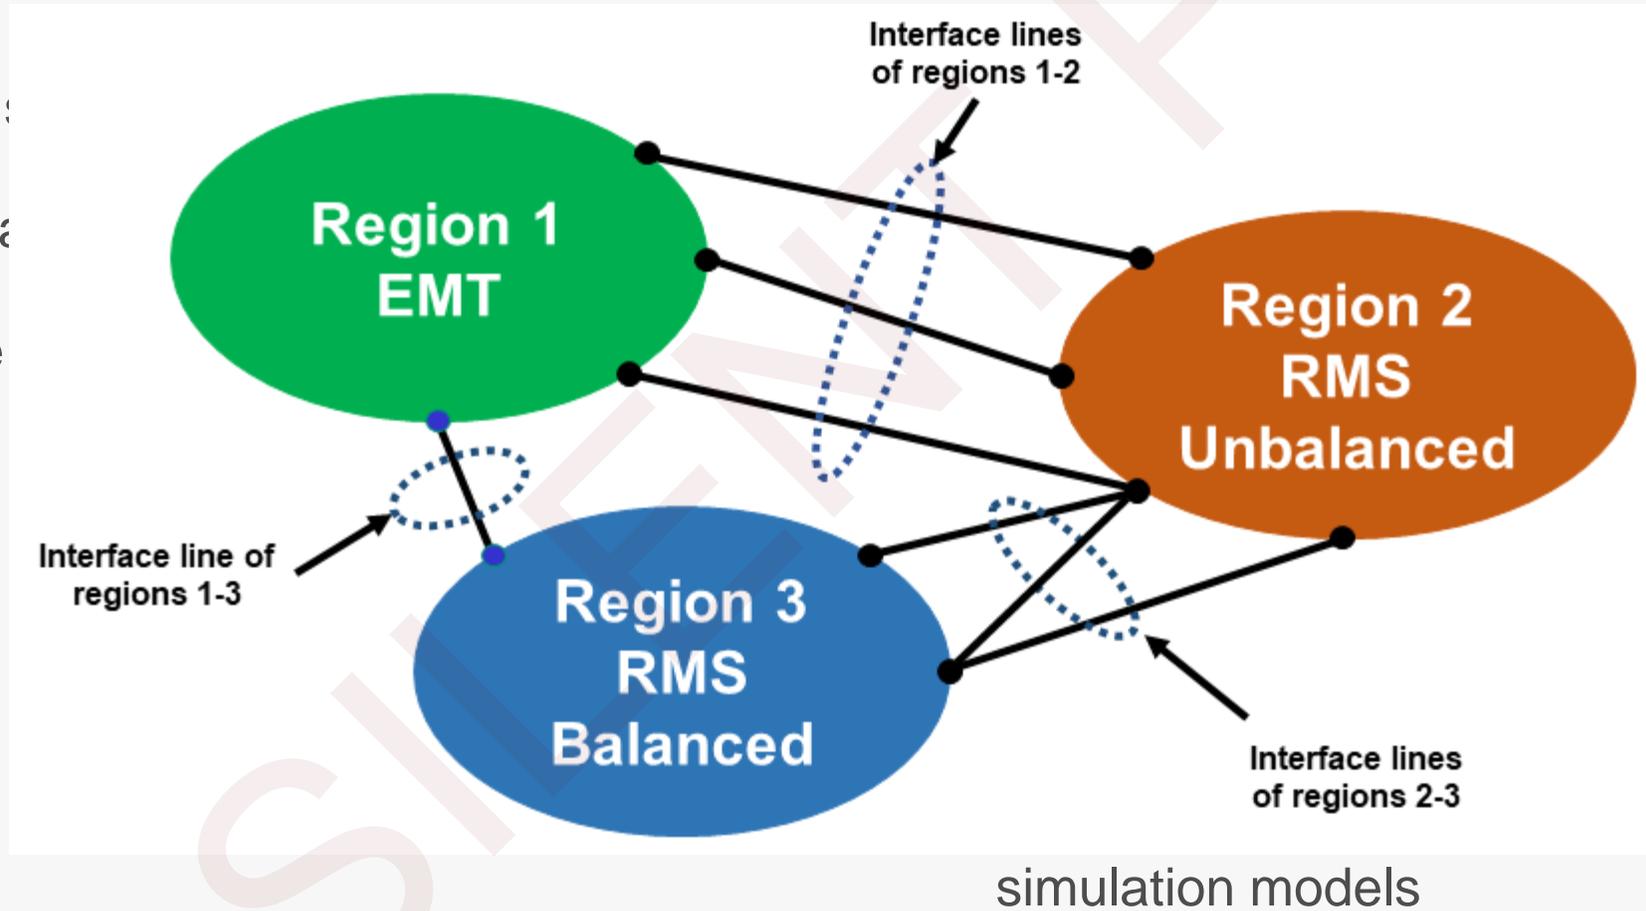

simulated in
ances:
ctory
C37.118
vices for
defined

Implicit Method


- Exact simulation results
- Using long wave traveling times on long lines
- Requires small step sizes according to the traveling times
- Might have a negative impact on the performance if the lines are not long enough

Explicit Method

- Approximate approach
- Does not require long lines
- Creating dynamic equivalents for the exchange of signals
- Might not be precise


Illustrative Study Case for Co-Simulation

- Synthetically created 2.000 bus example
- 432 running generation units
- Panhandle-Region includes only wind generation (627 MW)
- Four simulations have been considered:
 - Full RMS (balanced)
 - 0.15 ms step size
 - Full RMS (unbalanced)
 - 0.15 ms step size
 - Full EMT
 - 0.05 ms step size
 - RMS (balanced)/EMT co-simulation
 - 0.1 ms (RMS); 0.01 ms (EMT)

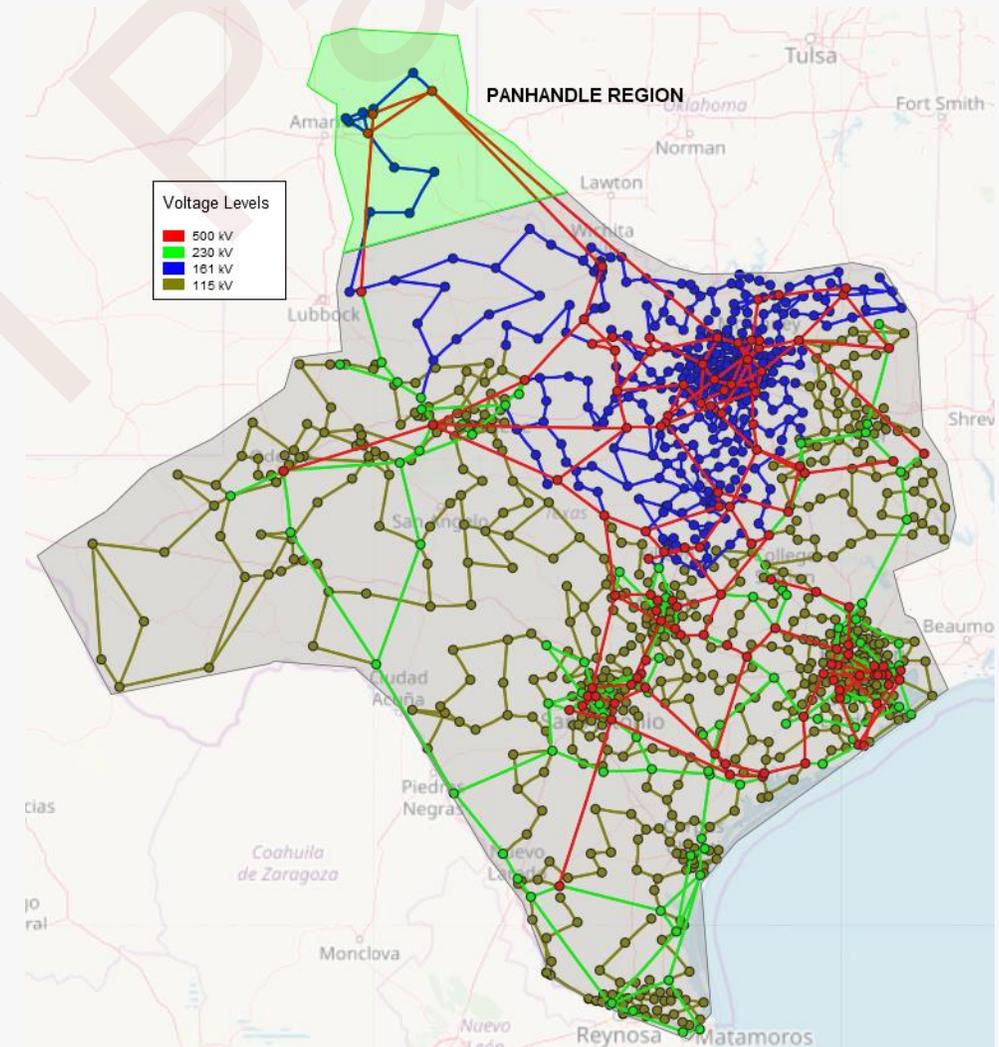


Example Simulations on the test network

- 1) Line fault with line switching after 100ms
- 2) Busbar fault with busbar switching after 100ms
- Voltages are recorded and shown for the busbar indicated as 3)
- EMT results are represented as RMS values

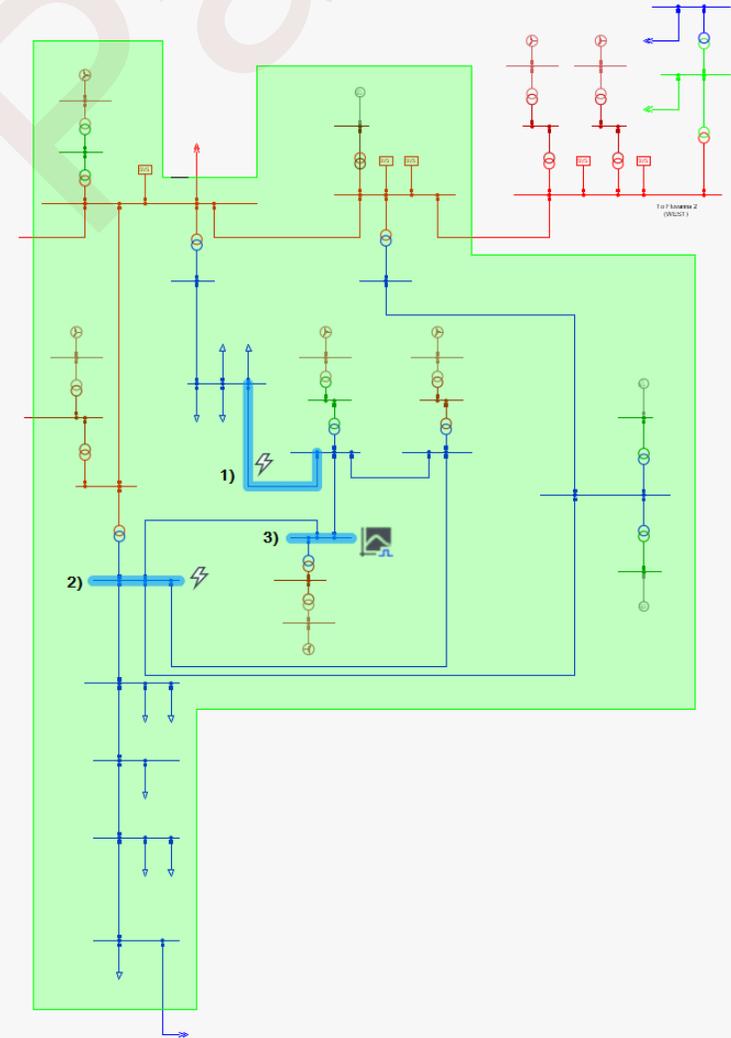


- All
- Res
- bal
- sim
- EM
- sim
- A s
- spil

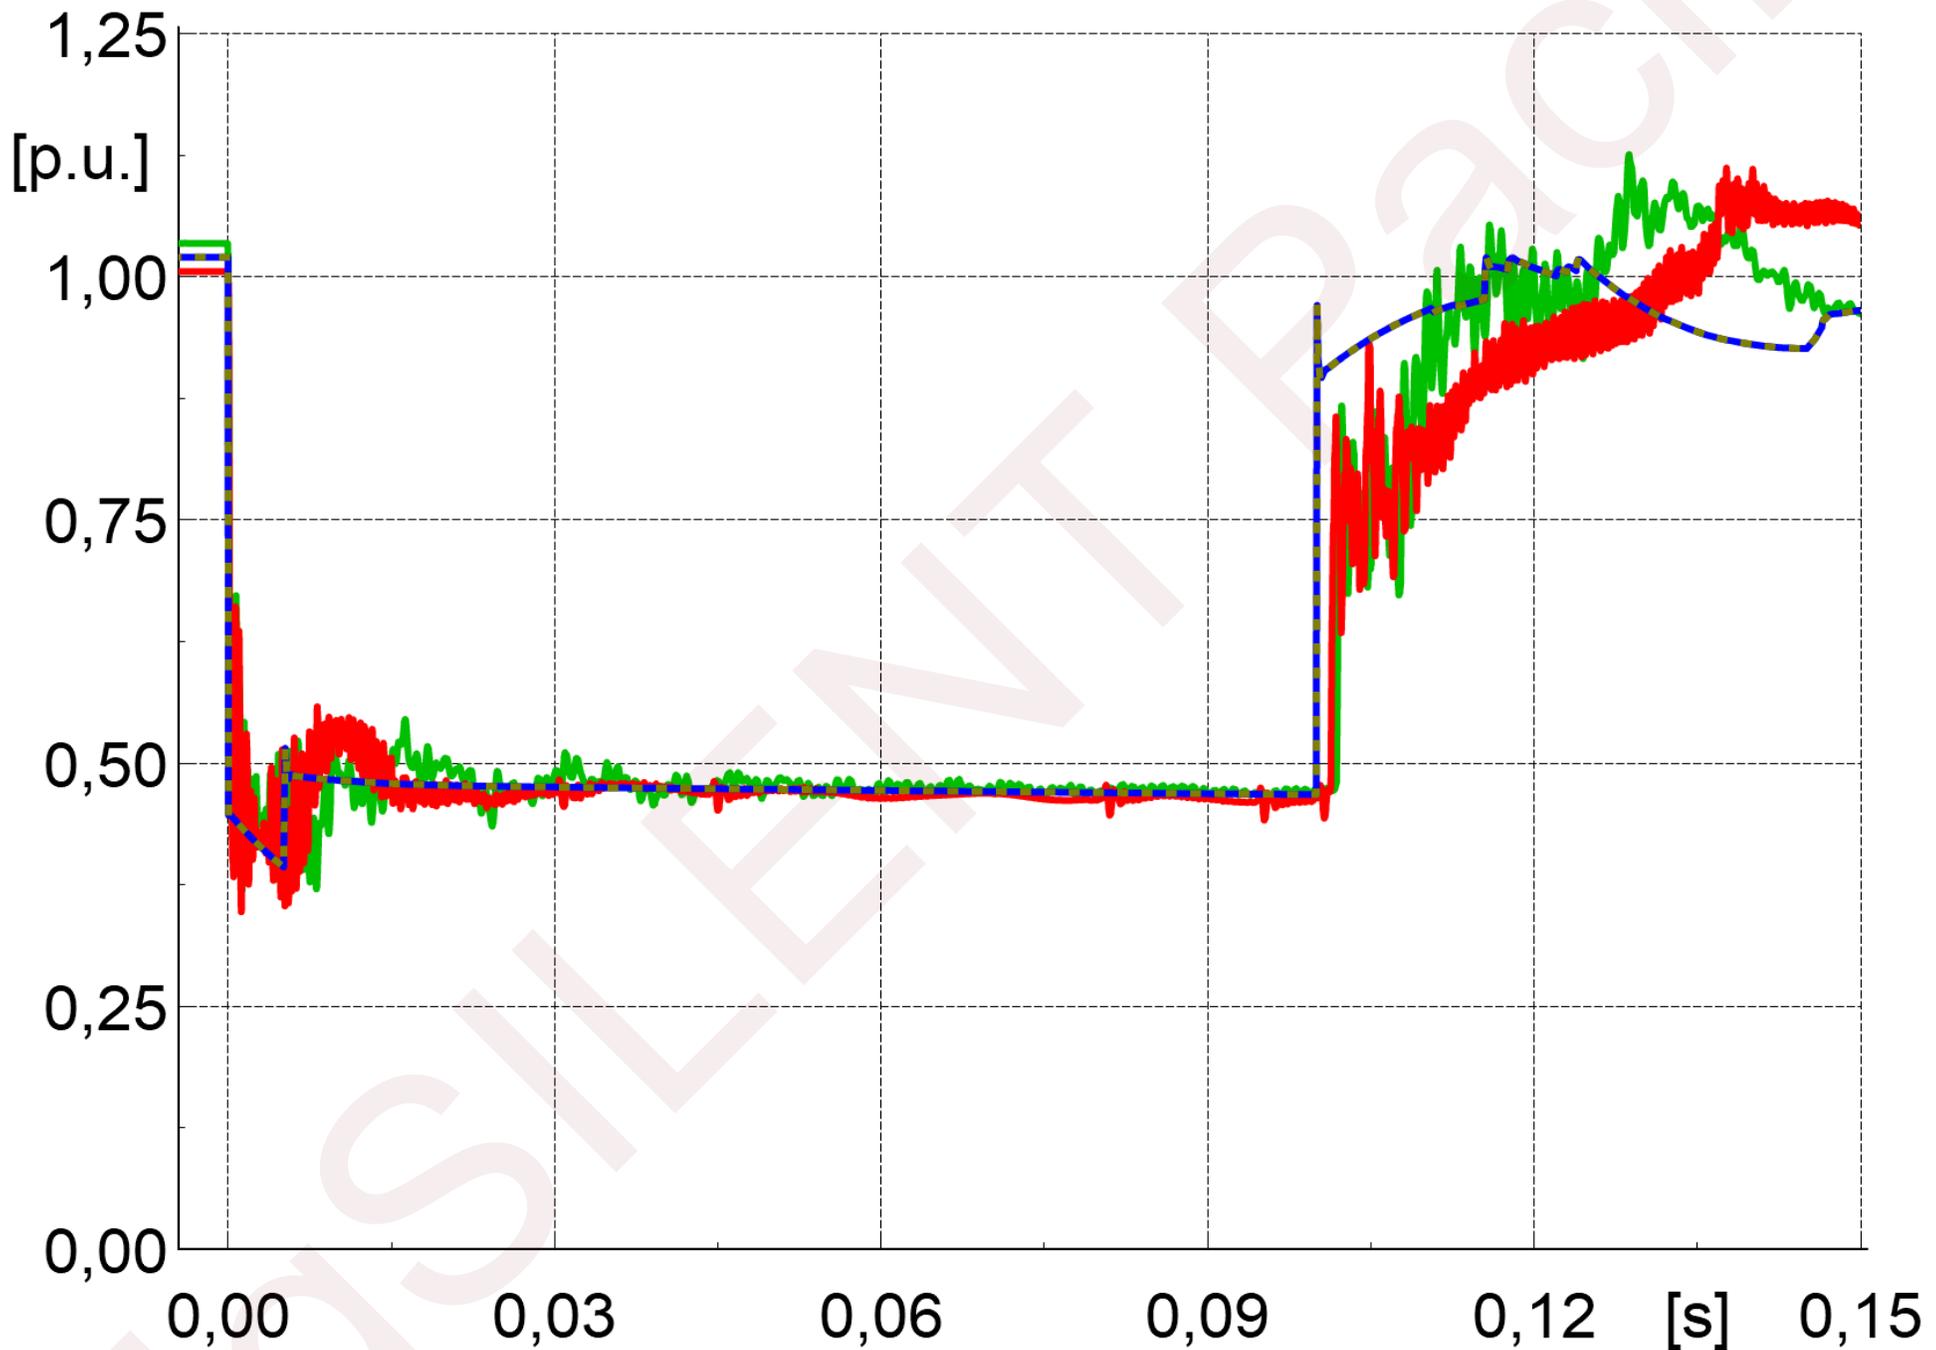



Results of the line fault 1) - Interpretation

- All simulations show a stable behavior after fault clearing
- The spikes shown in the EMT-based simulation might be relevant for a detailed analysis
- The need for an EMT-based simulation is limited
- **Co-simulation shows a good representation of the observed busbar**

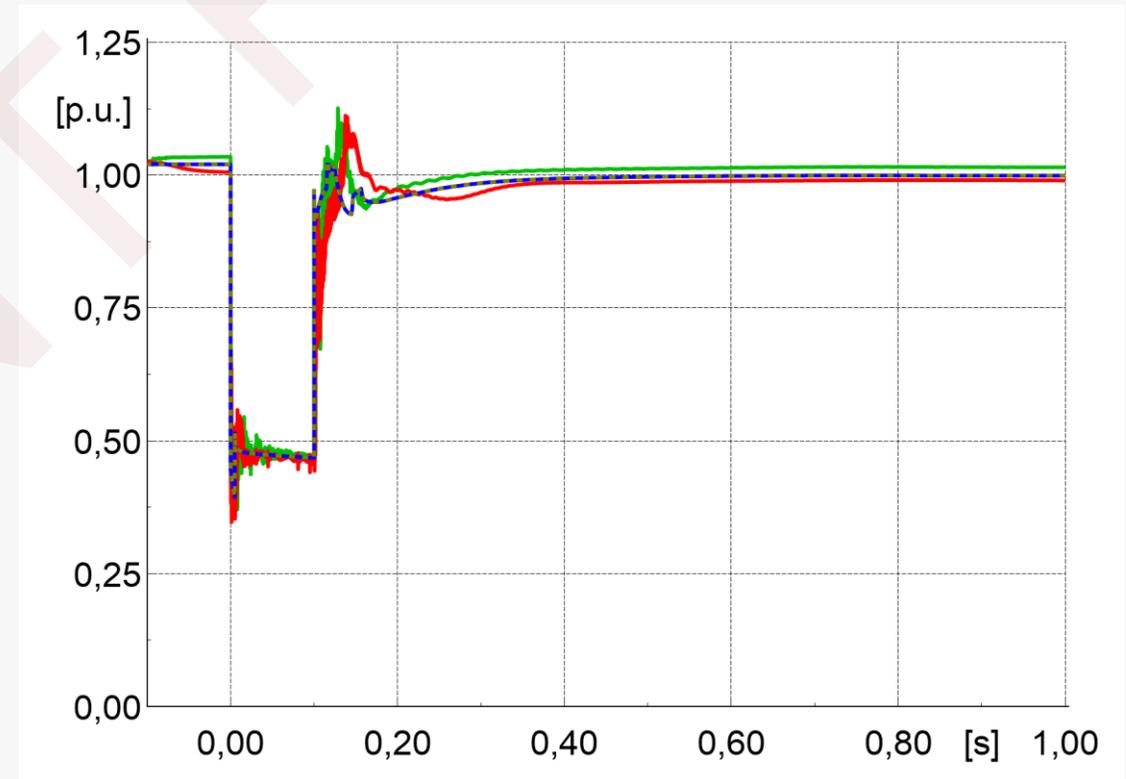


Resu

- Res
- bal
- sim
- EM
- sim
- The
- A st
- volt

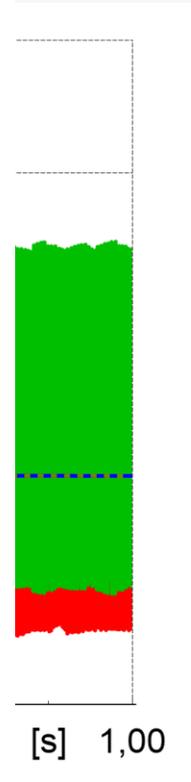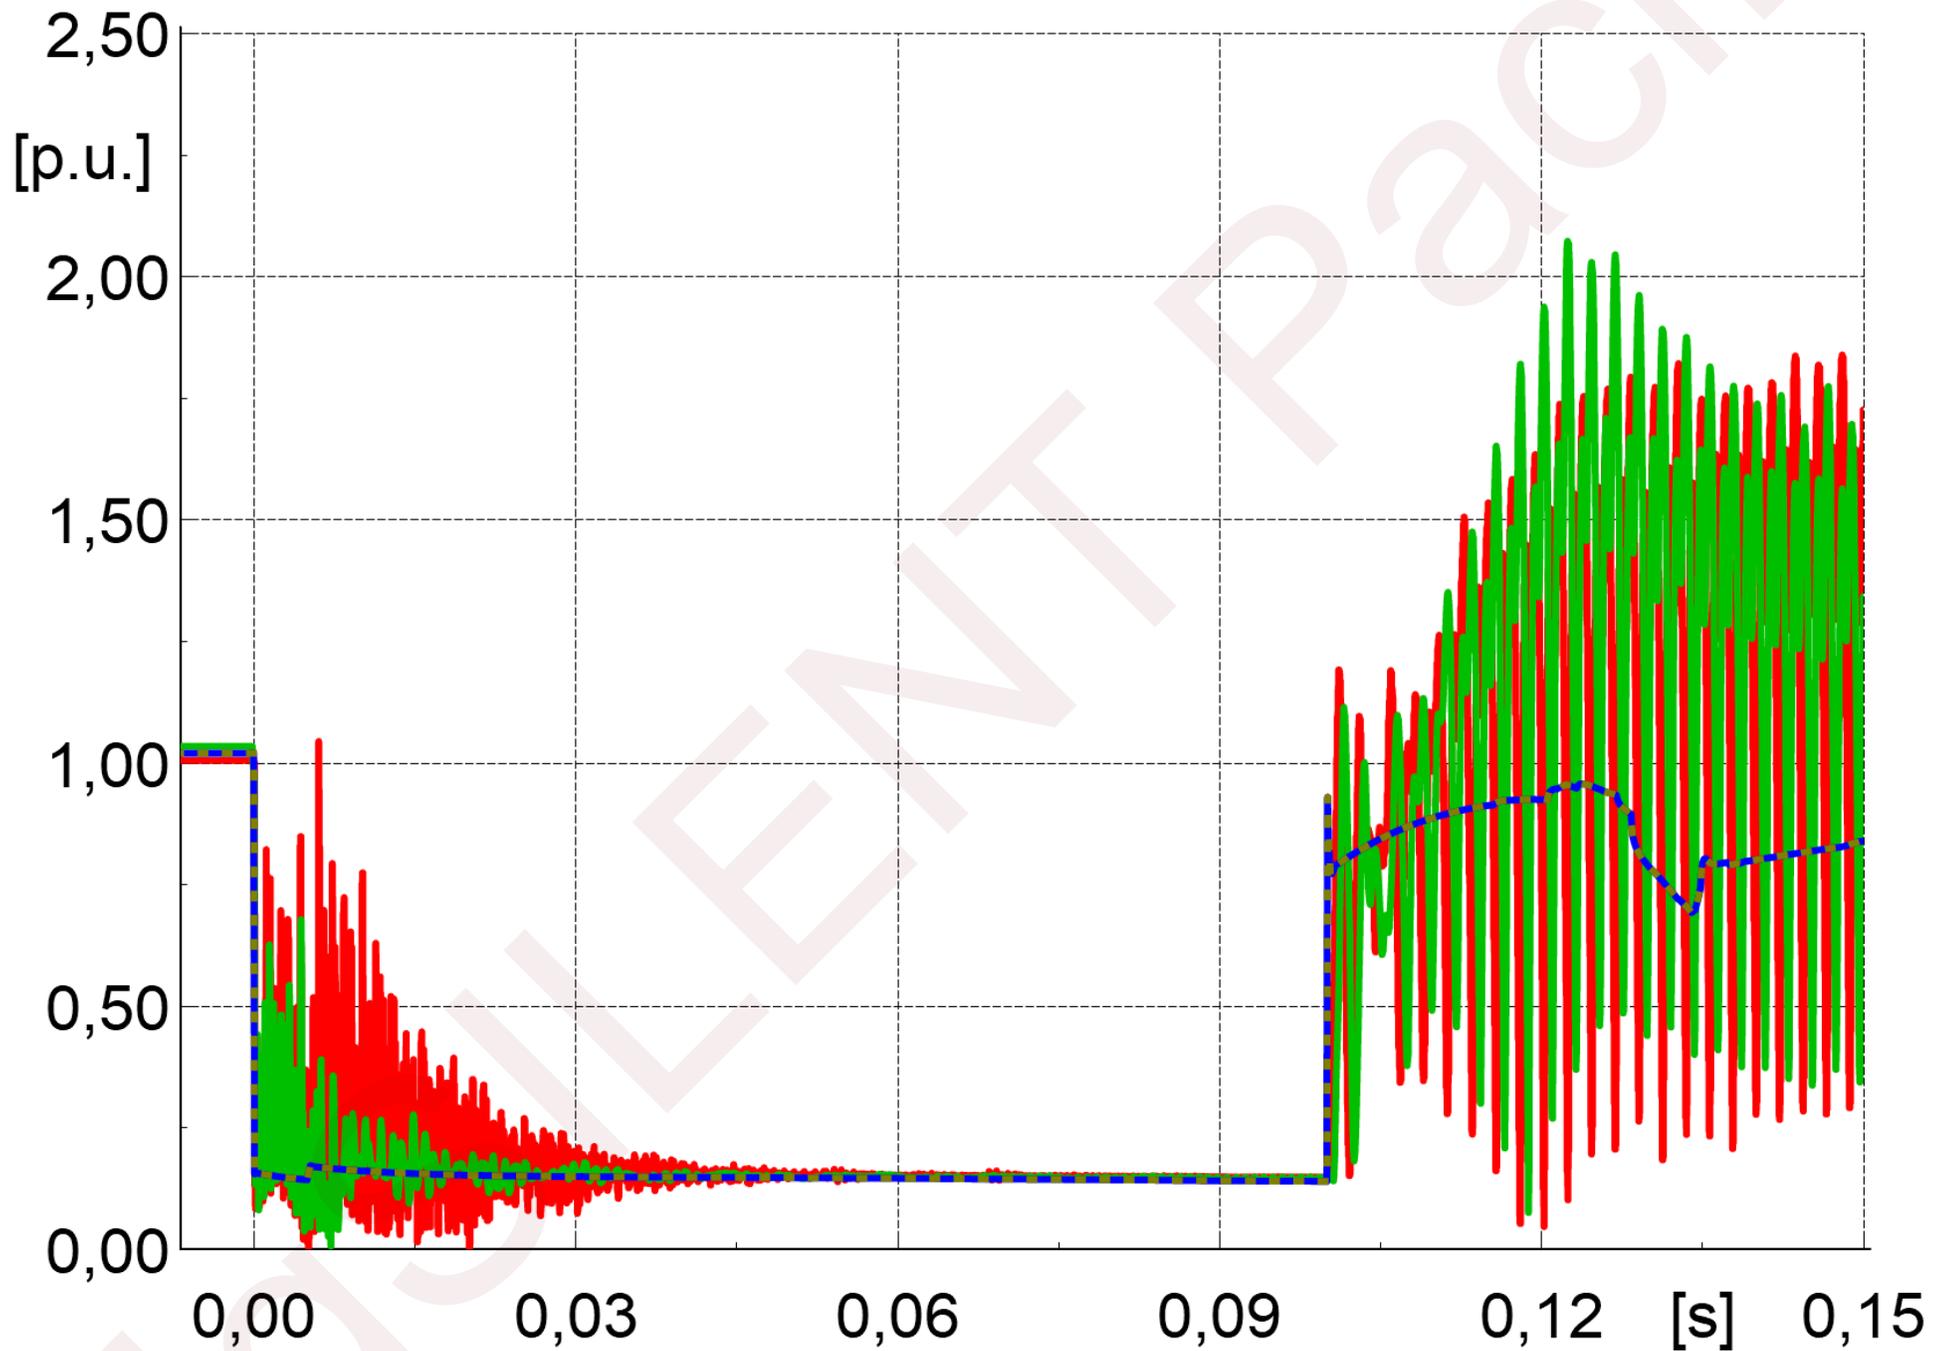


Results of the busbar 2) - Interpretation


- The EMT-based simulation show an unstable oscillation above 1 kHz due to controller interactions
- The need for an EMT-based simulation is shown in this example
- **The unstable behavior can be represented using the co-simulation within PowerFactory**

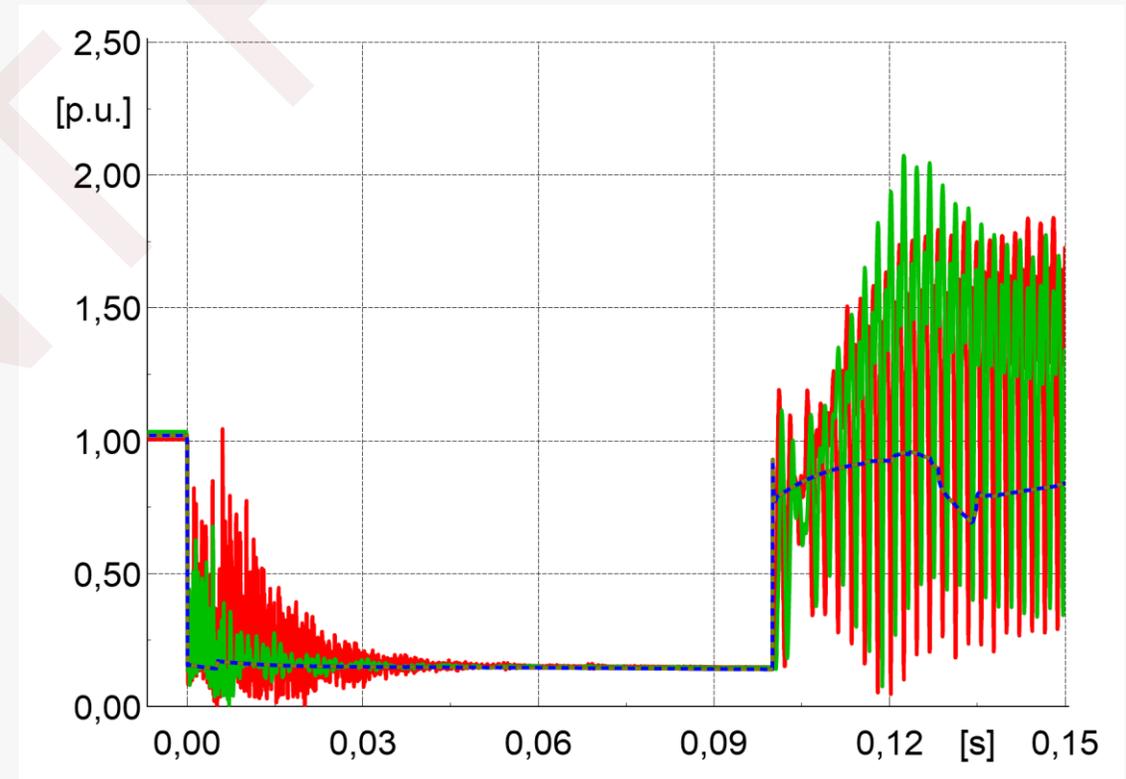

Comparison of relative simulation performance

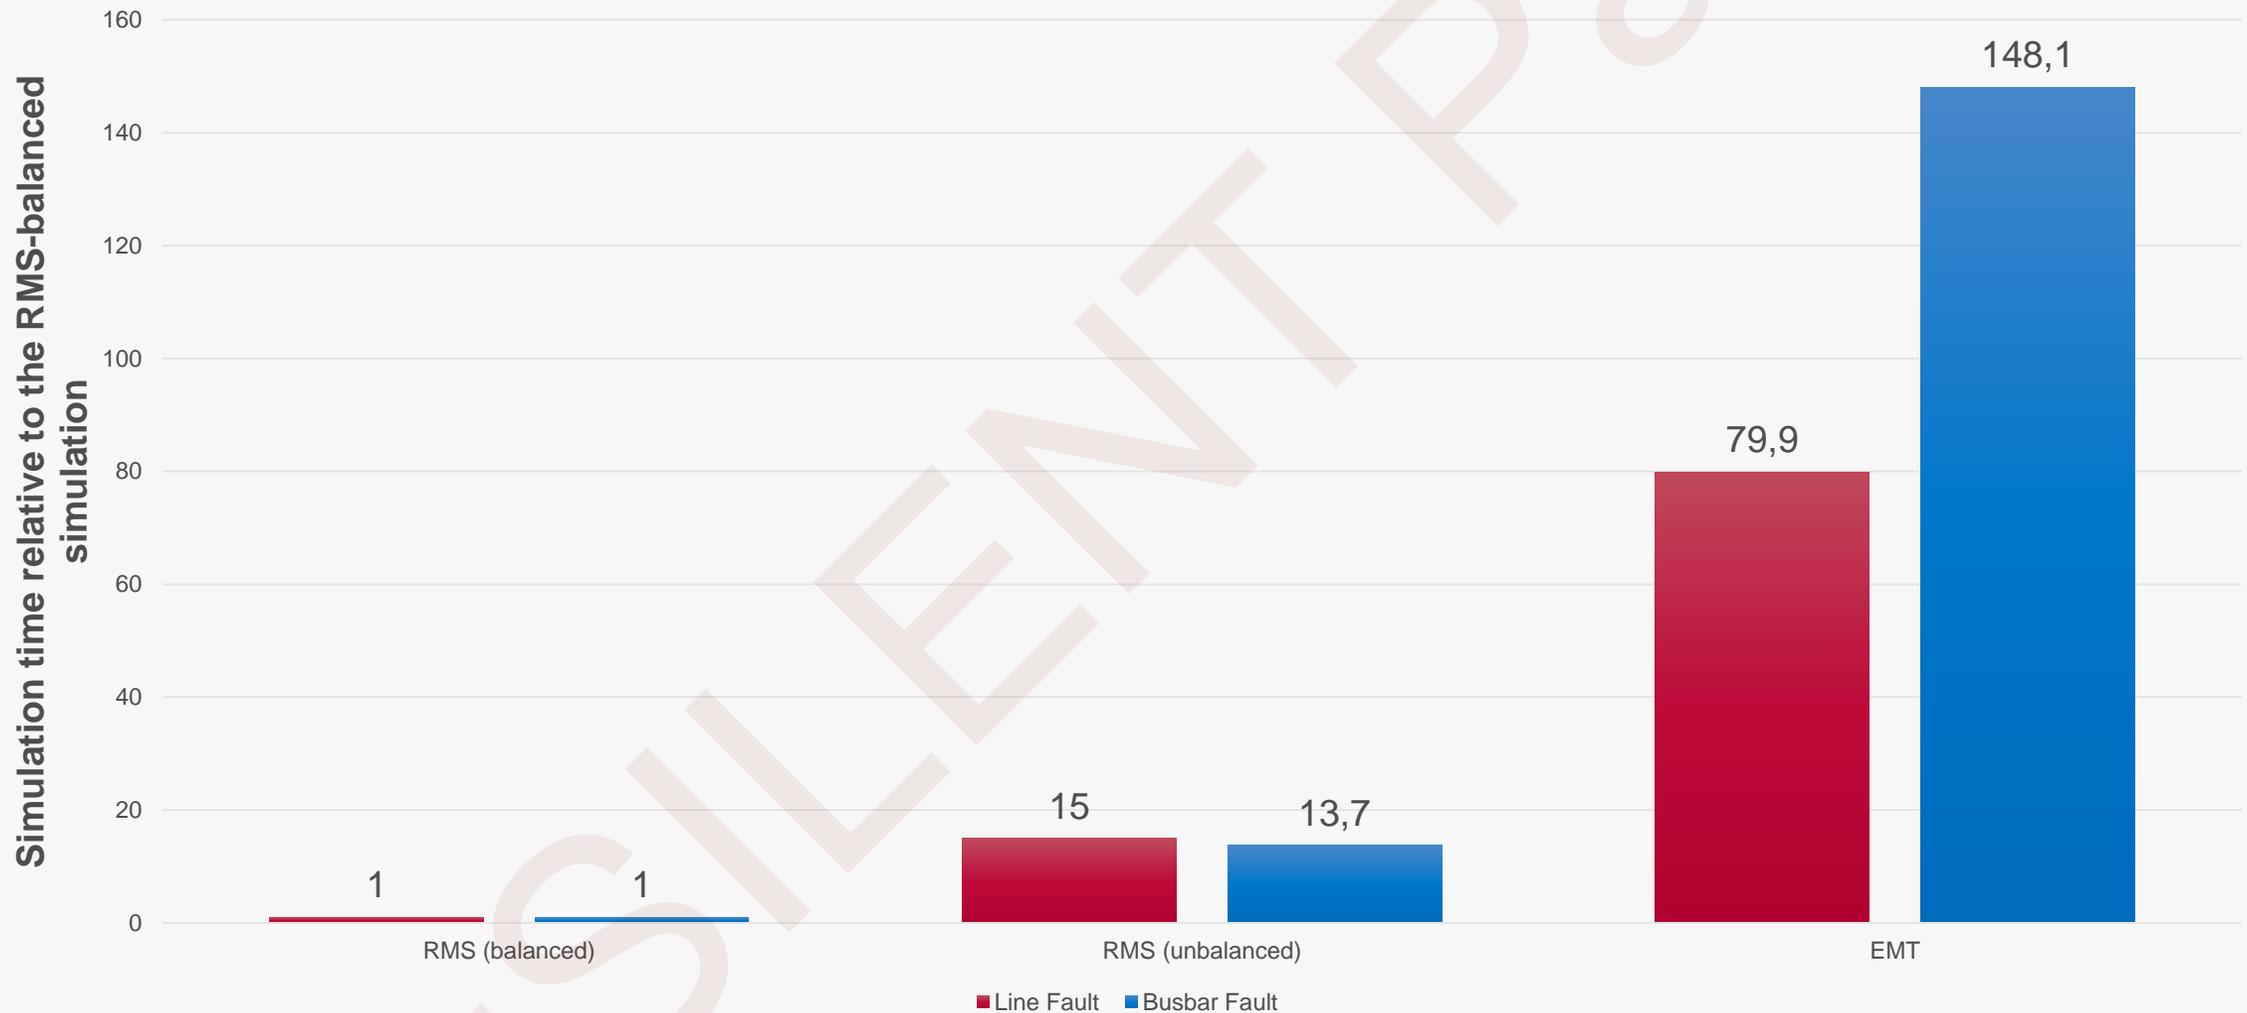

Comparison of relative simulation performance

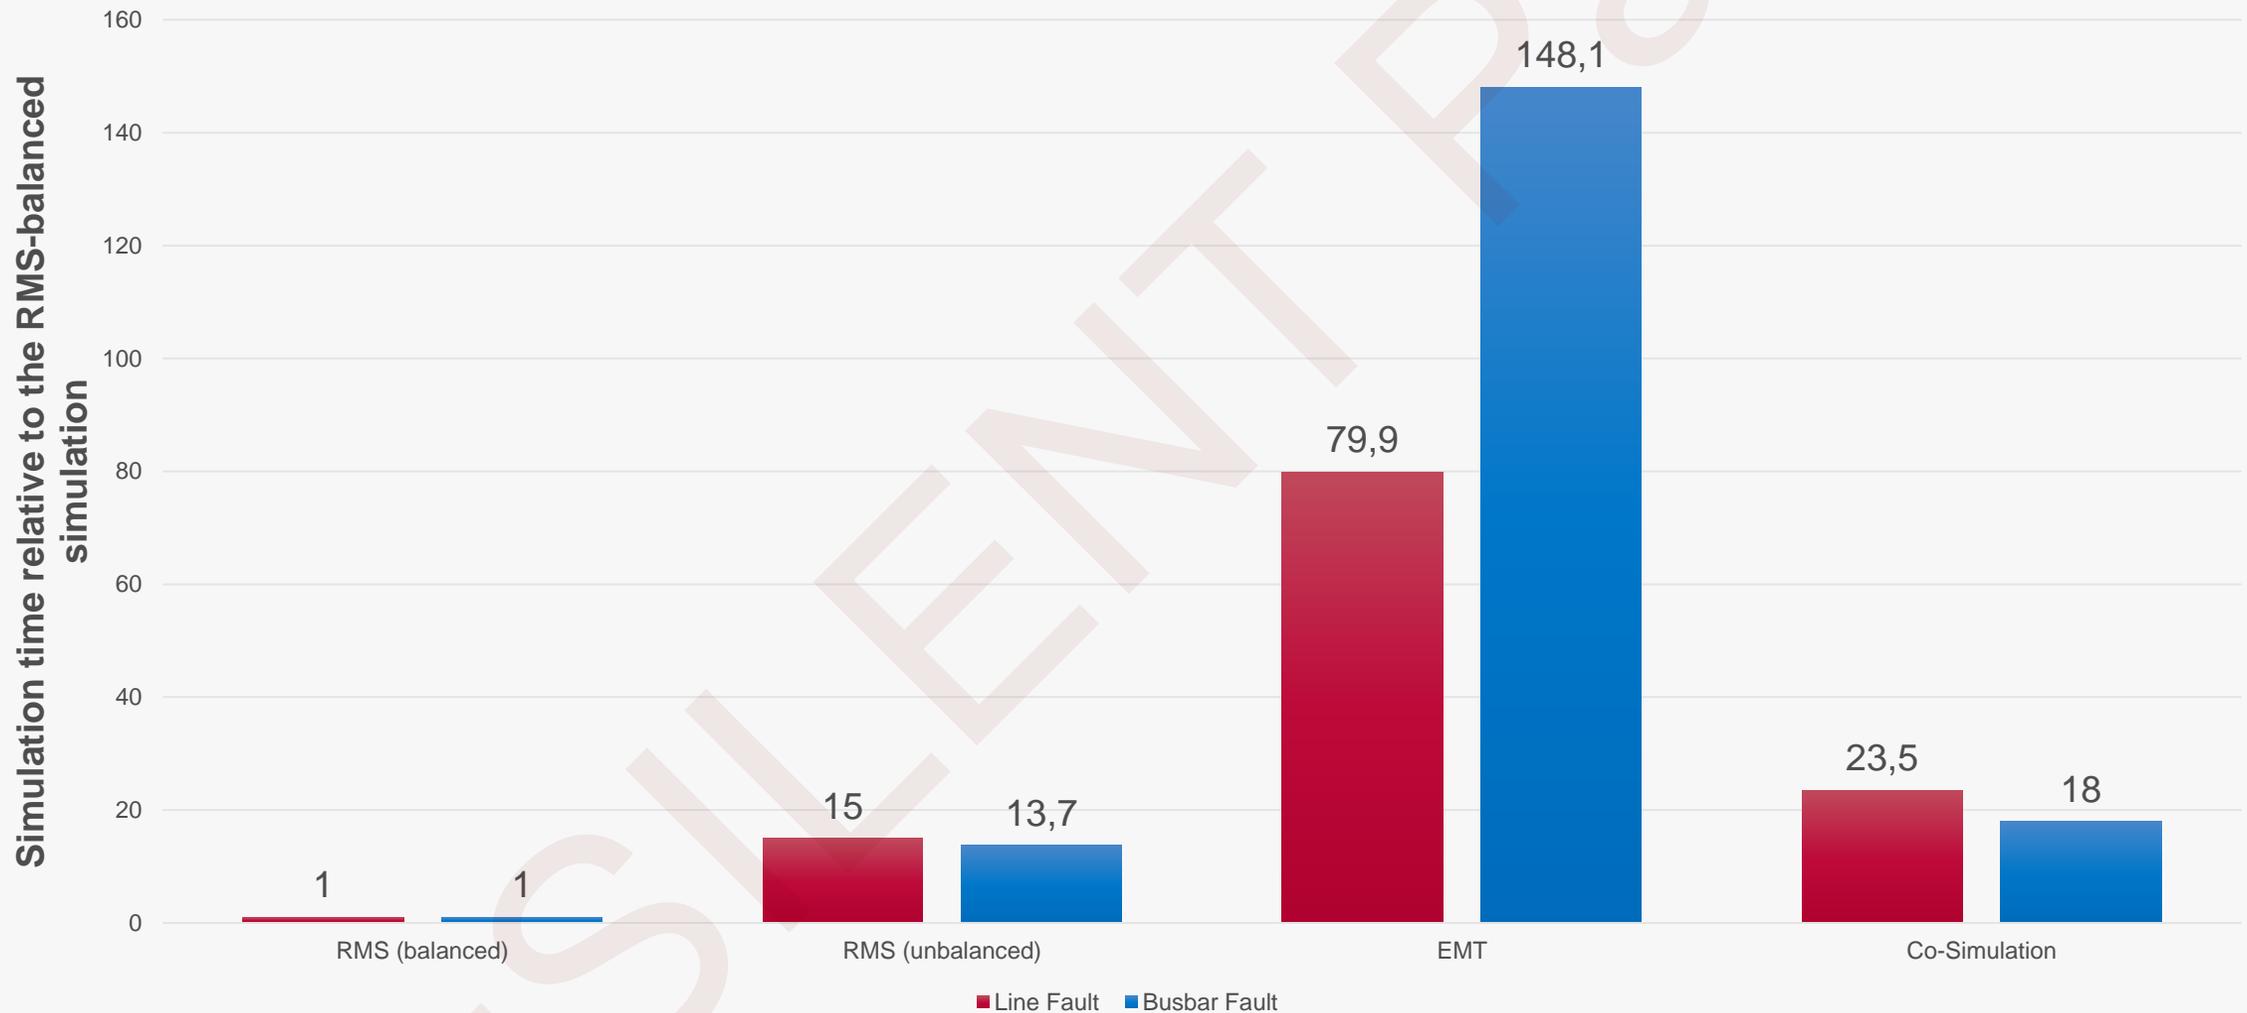

- The used test case shows that in some cases of PE-based simulations, an EMT-simulation might be required to observe certain phenomena
- Co-simulation within PowerFactory can be used to observe such phenomena without the need to run a full model on EMT-basis
- The co-simulation however, can reduce the time required for a detailed EMT-simulation for certain study regions
- Co-simulation techniques can further be used for cross-platform simulations

Thank you!